


Mobile Unit Water Tank Diagram

Typical Tank Layout

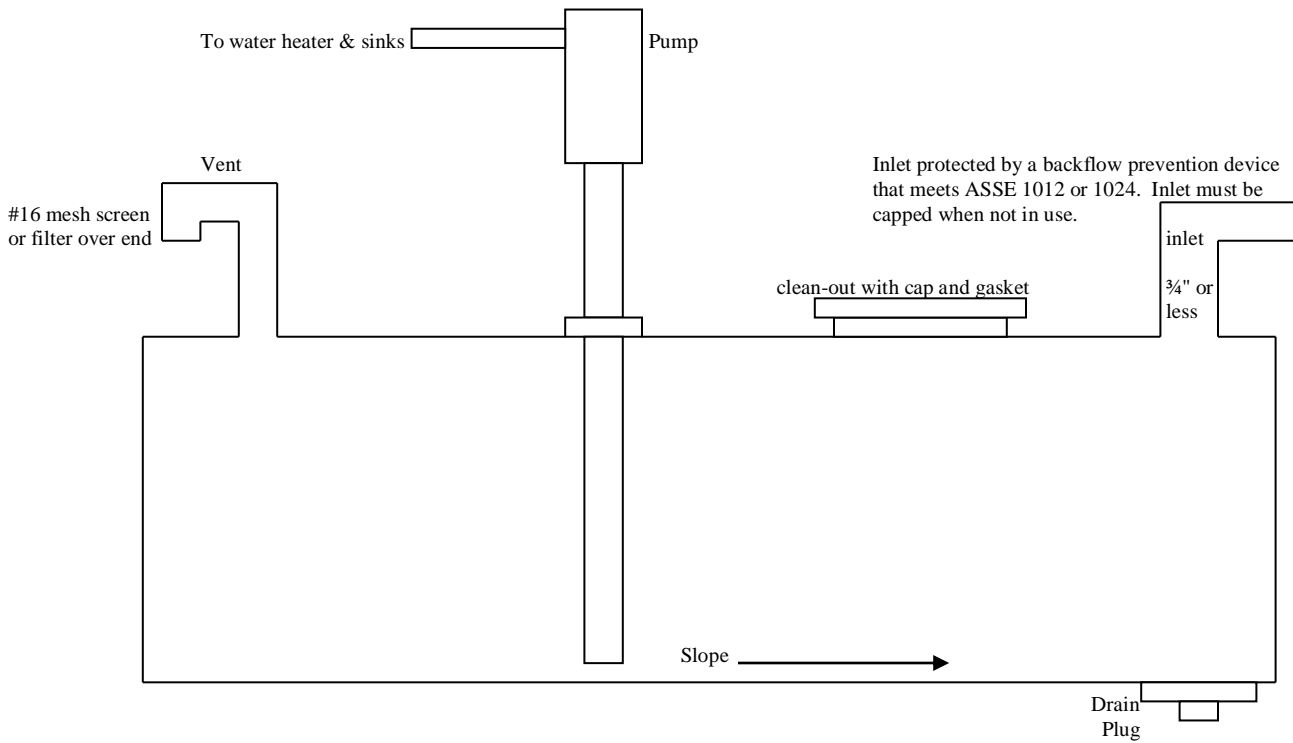

**** 3717-1-05.2 (K) - System flushing and disinfection** - Each year prior to use your mobile unit's water system should be disinfected with 200ppm strength bleach solution as required under 3701-28-17 of the Administrative Code. Use the following table to mix the strength of the bleach solution to be used.

Gallons of water	5.25% strength bleach	6.0% strength bleach
5	1/3 cup	¼ cup
10	2/3 cup	½ cup
15	1 cup	¾ cup
20	1 1/3 cups	1 cup
25	1 2/3 cups	1 1/4 cups

Bleach water should be circulated through all parts of the system including the hose, the entire inside of the water tank, the water heater (heater need not be on) and the faucets. Allow to stand in plumbing 8hrs.

This is a strong concentration of bleach; please take care to wear protective clothing, gloves and goggles. Do not mix bleach with any other chemicals. Do not use scented bleach. Flush with potable water after disinfecting.